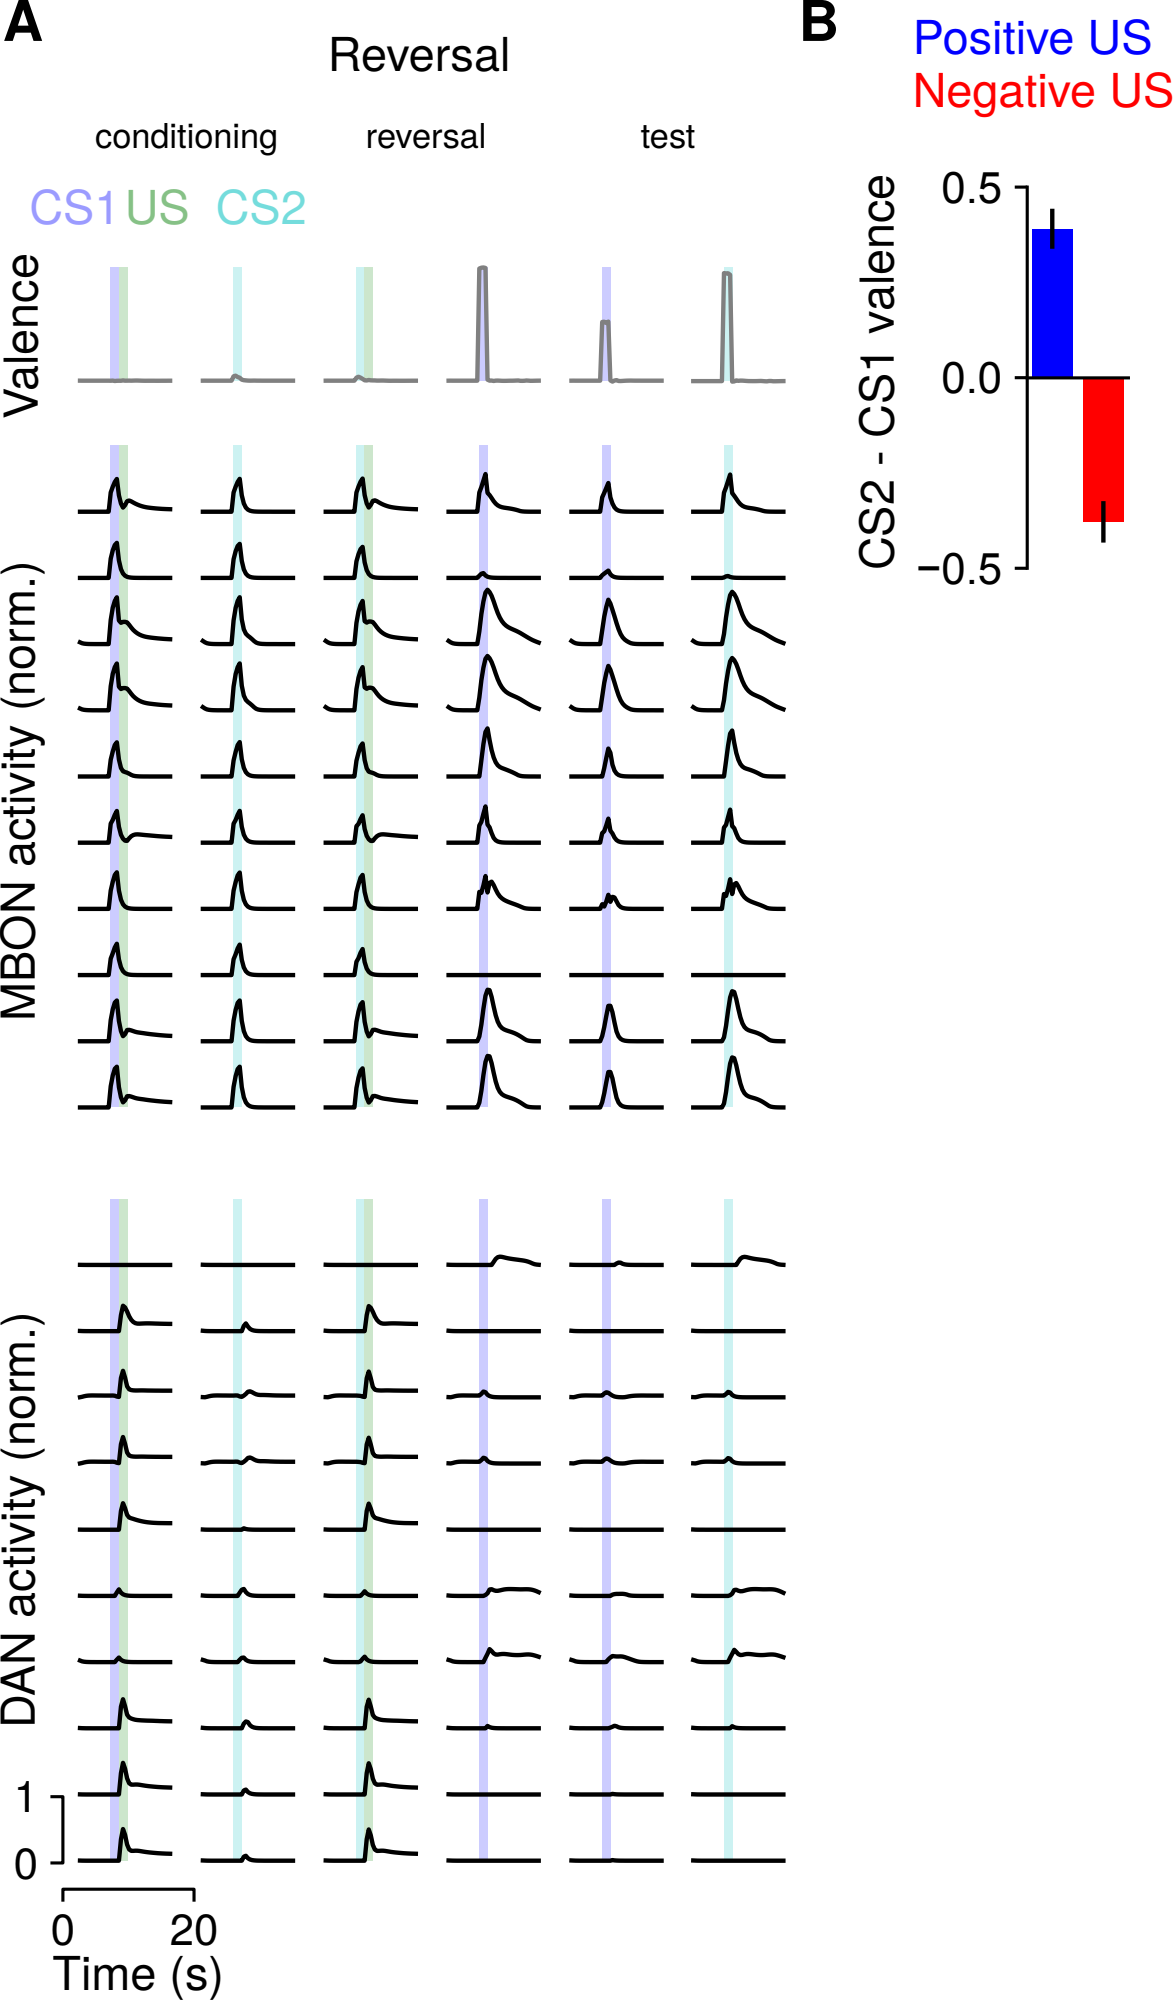
A
Reversal
conditioning
reversal
test
CS1
US
CS2
Valence
MBON activity (norm.)
DAN activity (norm.)
1
0
0
20
Time (s)
B
Positive US
Negative US
CS2 - CS1 valence
0.5
0.0
−0.5