
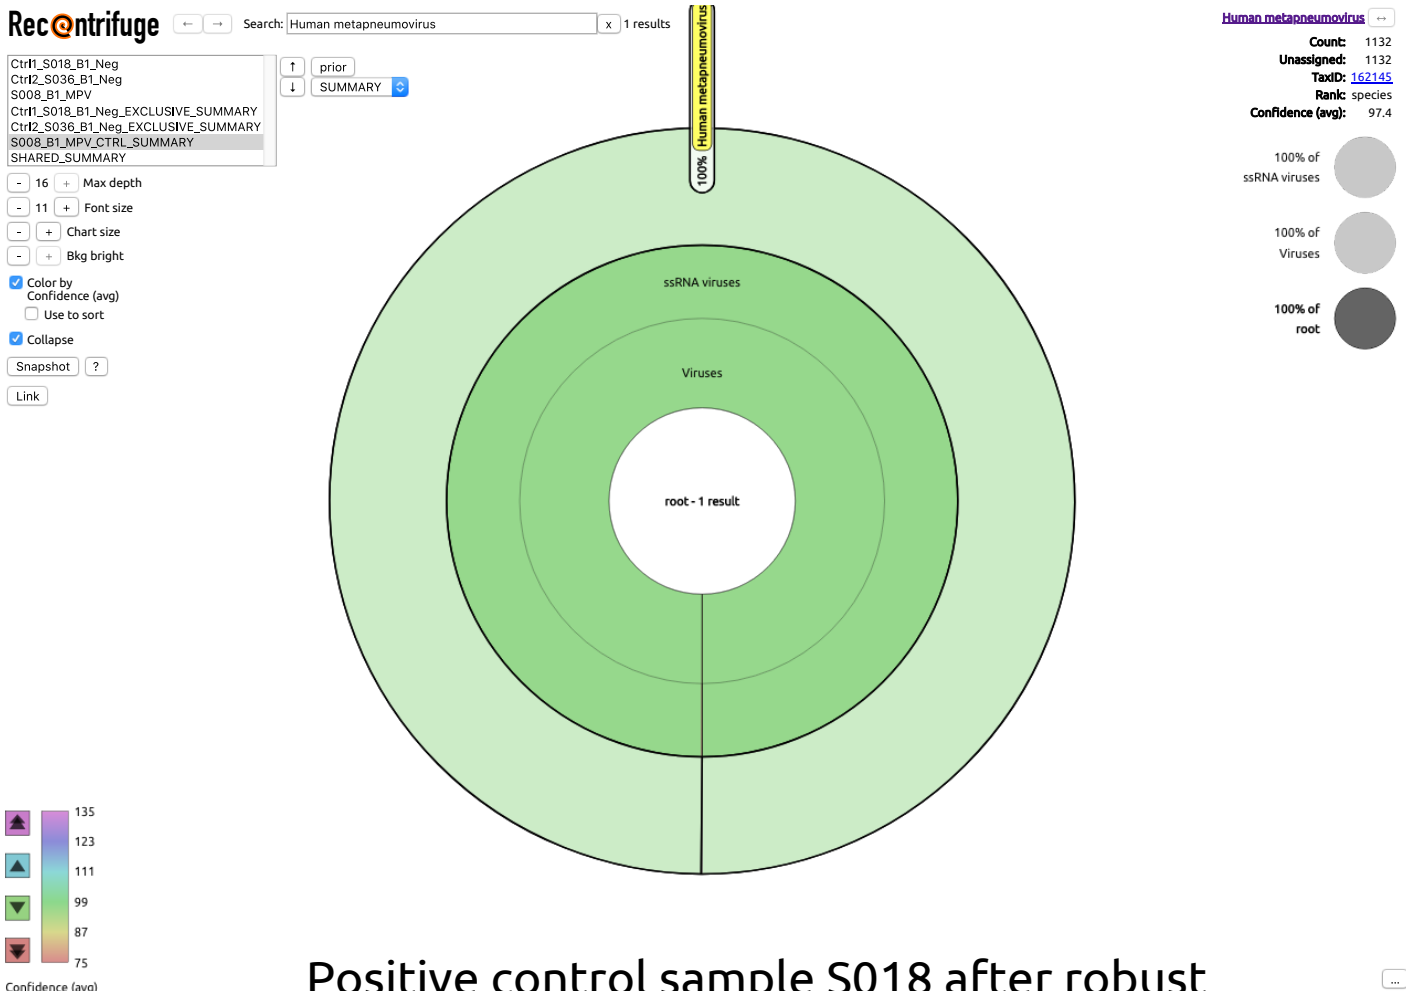


Negative control sample S018 (Ctrl1_S018_B1_Neg)

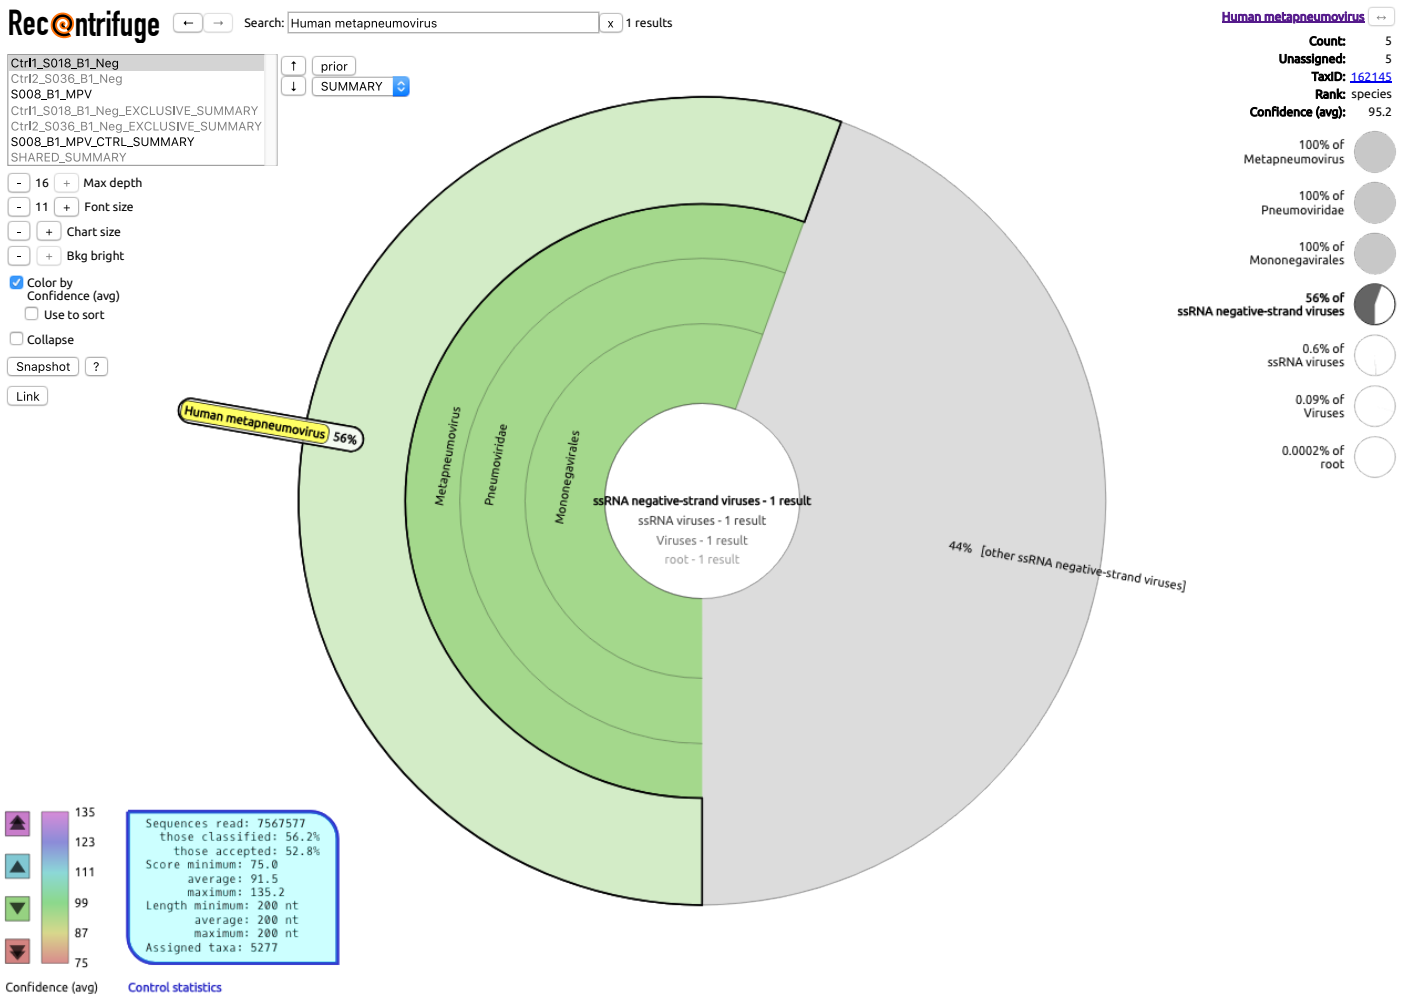

Positive control sample S018 after robust contamination removal (S008_B1_MPV_CTRL_SUMMARY)